



SECTION A-A

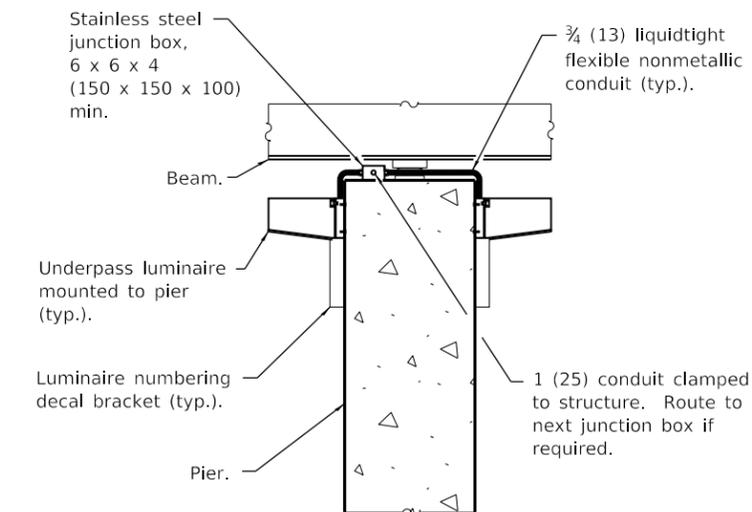


CENTER PIER DETAIL

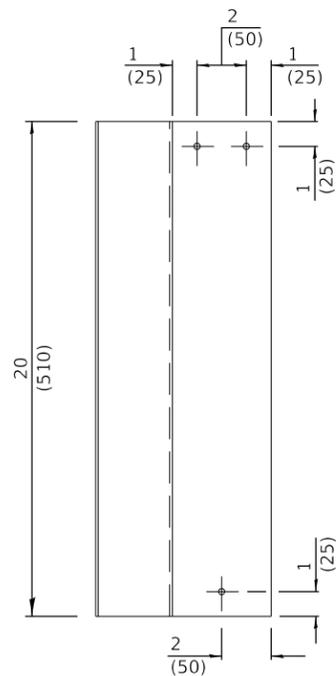


ELEVATION

LUMINAIRE NUMBERING DECAL BRACKET MOUNTING DETAIL

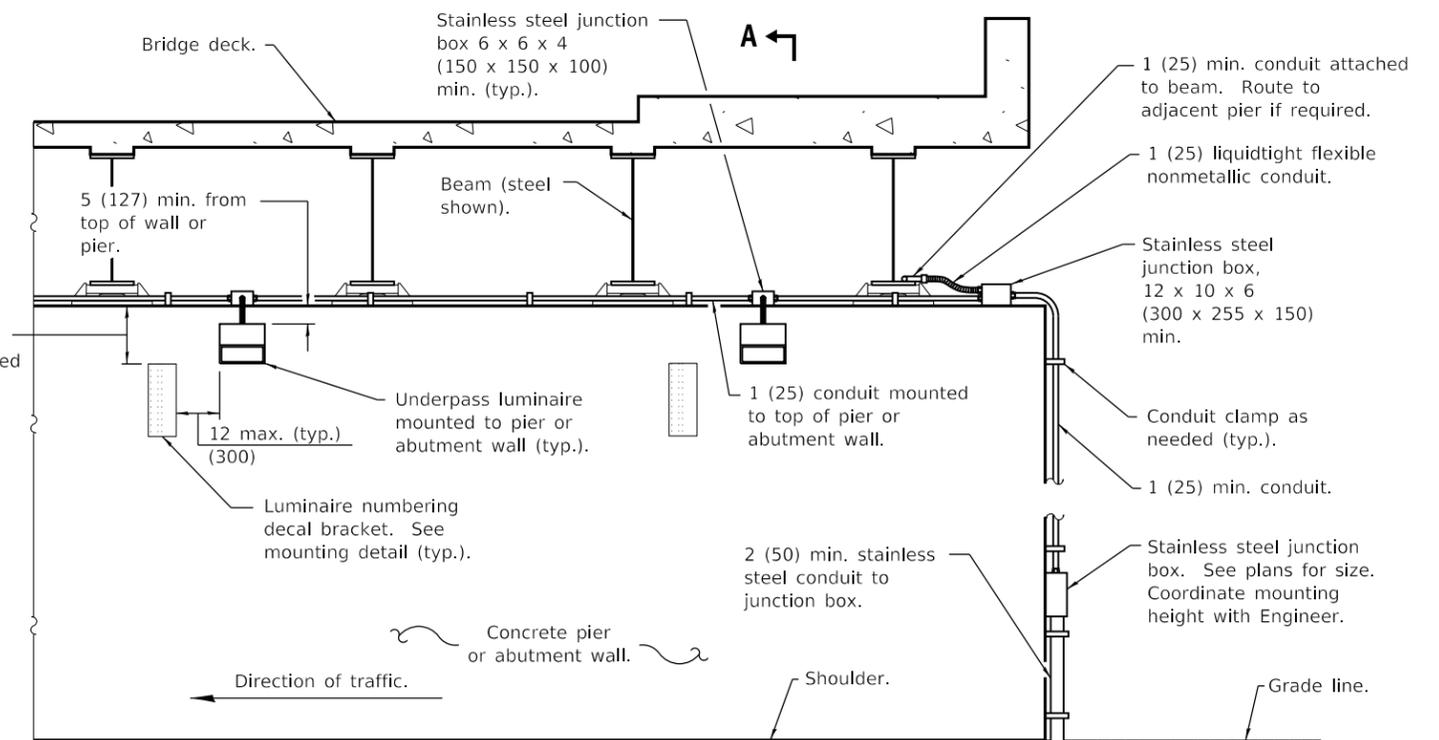

PIER / ABUTMENT WALL ELEVATION

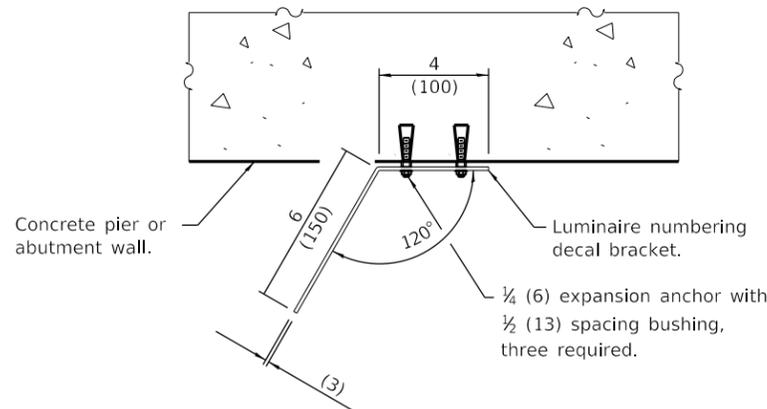

TOP VIEW



CONDUIT BEAM CLAMP



CONDUIT CLAMP

GENERAL NOTES

See plans for underpass luminaire locations.

Rigid conduit may be used in lieu of flexible conduit.

Stainless steel conduit shall be used beneath any openings in the bridge deck.

Branch circuits to luminaire shown routed from underground. Branch circuits may be routed from bridge parapet above.

All dimensions are in inches (millimeters) unless otherwise shown.

DATE	REVISIONS
4-1-16	New standard.

UNDERPASS LIGHTING WALL MOUNT

STANDARD 821001

Illinois Department of Transportation

PASSED April 1, 2016

ENGINEER OF PRELIMINARY ENGINEERING

APPROVED April 1, 2016

ENGINEER OF DESIGN AND ENVIRONMENT

ISSUED 1-1-16