



**ELEVATION**

\* This dimension shall be increased by 1/2 (38) for CIP field construction.

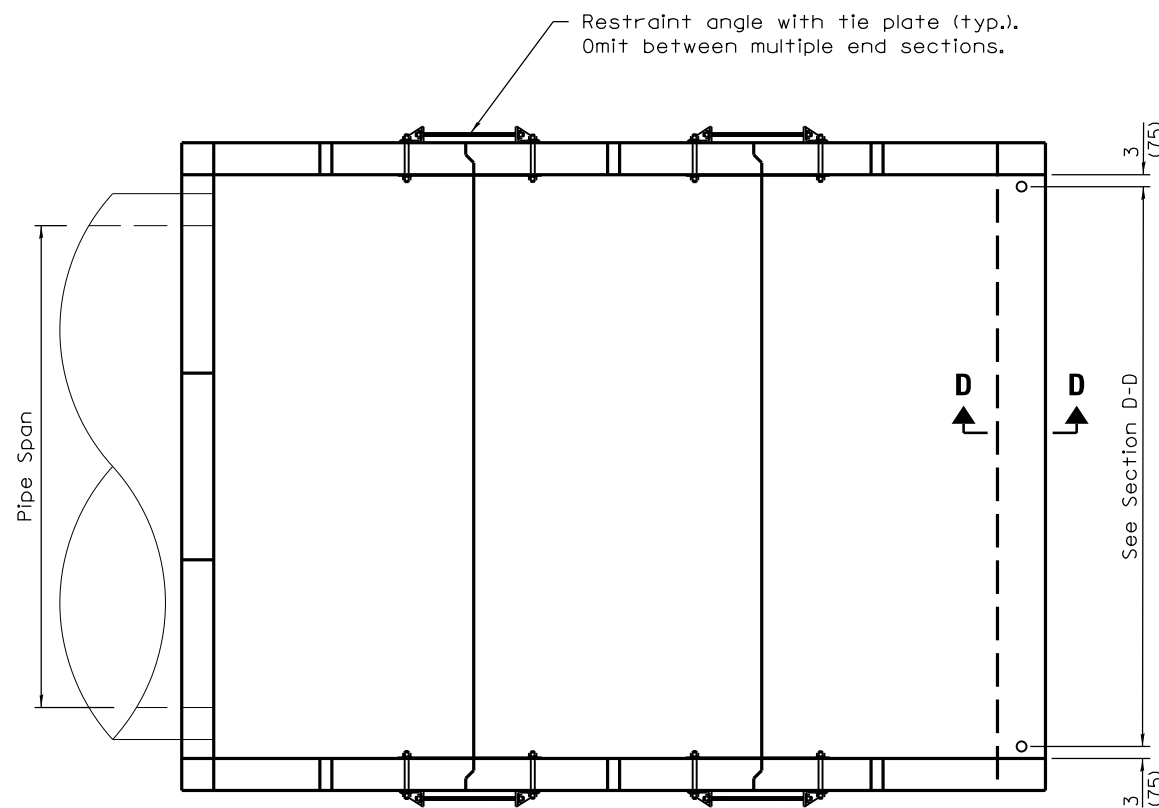

**PLAN**

8 (200) min. for EORS < 21 (525)  
12 (300) min. for EORS ≥ 21 (525)

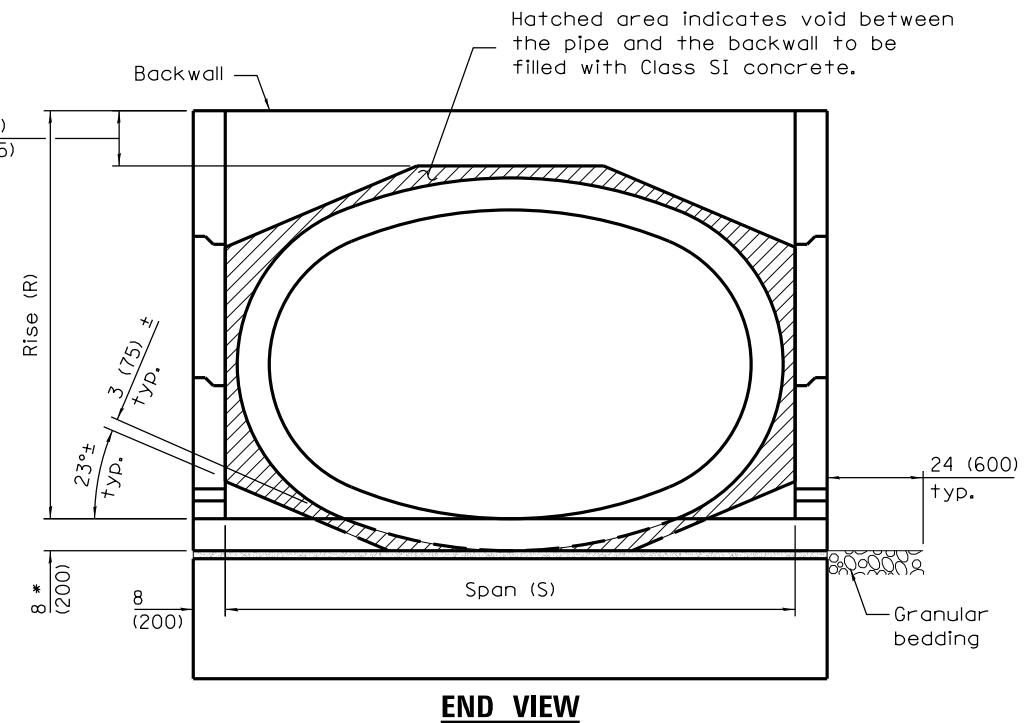

**END VIEW**

**PIPE CULVERT END SECTION DIMENSIONS**

Equivalent Round Size Pipe I.D.	Pipe Span	Pipe Rise	A	R	S	L			
						Slope of End Section			
						1:2	1:3	1:4	1:6
15 (375)	23 (575)	14 (350)	15 (375)	28 (711)	36 (914)	5'-4" (1.62 m)	7'-8" (2.34 m)	10'-0" (3.05 m)	14'-8" (4.47 m)
18 (450)	23 (575)	14 (350)	15 (375)	28 (711)	36 (914)	5'-4" (1.62 m)	7'-8" (2.34 m)	10'-0" (3.05 m)	14'-8" (4.47 m)
21 (525)	30 (750)	19 (475)	15 (375)	38 (965)	3'-8" (1.12 m)	7'-0" (2.14 m)	10'-2" (3.10 m)	13'-4" (4.07 m)	19'-8" (6.00 m)
24 (600)	30 (750)	19 (475)	15 (375)	38 (965)	3'-8" (1.12 m)	7'-0" (2.14 m)	10'-2" (3.10 m)	13'-4" (4.07 m)	19'-8" (6.00 m)
27 (675)	34 (850)	22 (550)	15 (375)	3'-5" (1.04 m)	4'-0" (1.22 m)	7'-6" (2.29 m)	10'-11" (3.33 m)	14'-4" (4.38 m)	21'-2" (6.46 m)
30 (750)	38 (950)	24 (600)	15 (375)	3'-7" (1.09 m)	4'-4" (1.32 m)	7'-10" (2.39 m)	11'-5" (3.48 m)	15'-0" (4.57 m)	22'-2" (6.75 m)
36 (900)	45 (1125)	29 (725)	16 (400)	4'-1" (1.24 m)	5'-0" (1.52 m)	8'-10" (2.69 m)	12'-11" (3.94 m)	17'-0" (5.18 m)	25'-2" (7.67 m)
42 (1050)	53 (1325)	34 (850)	16 (400)	4'-6" (1.37 m)	5'-10" (1.78 m)	9'-8" (2.95 m)	14'-2" (4.32 m)	18'-8" (5.69 m)	27'-8" (8.44 m)
48 (1200)	60 (1500)	38 (950)	17 (425)	4'-11" (1.50 m)	6'-6" (1.98 m)	10'-6" (3.20 m)	15'-5" (4.71 m)	20'-4" (6.21 m)	30'-2" (9.21 m)
54 (1350)	68 (1700)	43 (1075)	17 (425)	5'-4" (1.63 m)	7'-2" (2.18 m)	11'-4" (3.45 m)	16'-8" (5.08 m)	22'-0" (6.71 m)	32'-8" (9.96 m)
60 (1500)	76 (1900)	48 (1200)	18 (450)	5'-10" (1.78 m)	8'-0" (2.44 m)	12'-4" (3.76 m)	18'-2" (5.54 m)	24'-0" (7.32 m)	35'-8" (10.87 m)
66 (1650)	83 (2075)	53 (1325)	18 (450)	6'-3" (1.91 m)	8'-8" (2.64 m)	13'-2" (4.02 m)	19'-5" (5.92 m)	25'-8" (7.83 m)	38'-2" (11.64 m)
72 (1800)	91 (2275)	58 (1450)	19 (475)	6'-9" (2.06 m)	9'-4" (2.84 m)	14'-2" (4.32 m)	20'-11" (6.38 m)	27'-8" (8.44 m)	41'-2" (12.56 m)

See Sheet 3 for GENERAL NOTES.

DATE	REVISIONS
4-15-16	Added general note for multiple end sections.
4-1-16	Added note to omit restraint angle and tie plate for mult. end sections.

**CONCRETE END SECTIONS FOR ELLIPTICAL PIPE CULVERTS 15" (375 mm) THRU 72" (1800 mm) EQUIVALENT DIAMETER**

(Sheet 1 of 3)


**STANDARD 542011-02**

Illinois Department of Transportation


APPROVED April 15, 2016  
ENGINEER OF BRIDGES AND STRUCTURES

APPROVED April 15, 2016  
ENGINEER OF DESIGN AND ENVIRONMENT


ISSUED 1-1-13

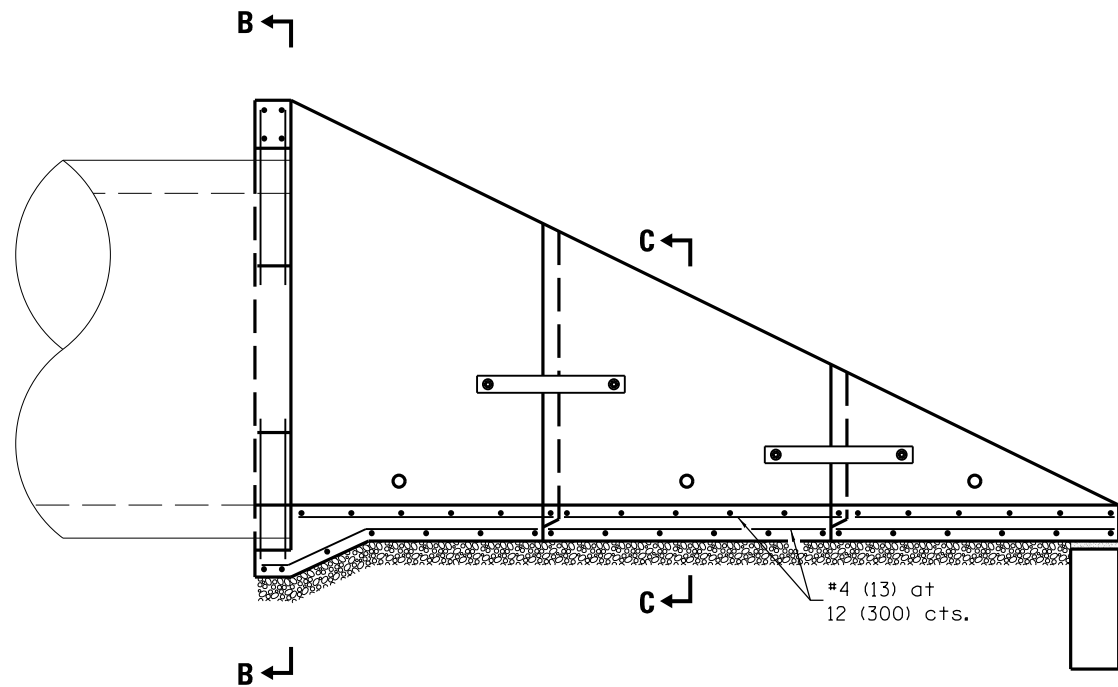

**LONGITUDINAL SECTION**  
(Showing bottom slab and backwall reinforcement.)

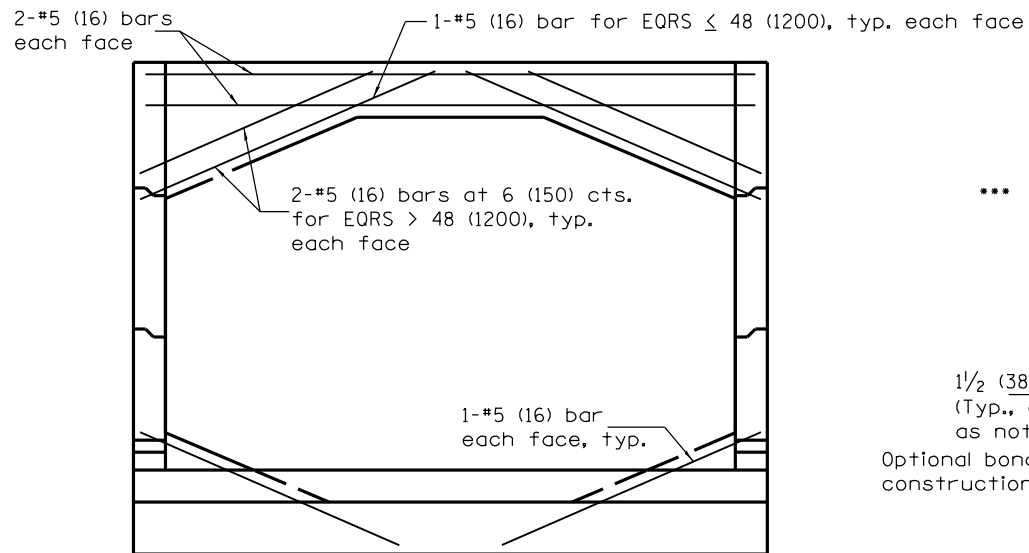

**SECTION B-B**  
(Showing backwall reinforcement only.)  
(Pipe omitted for clarity.)

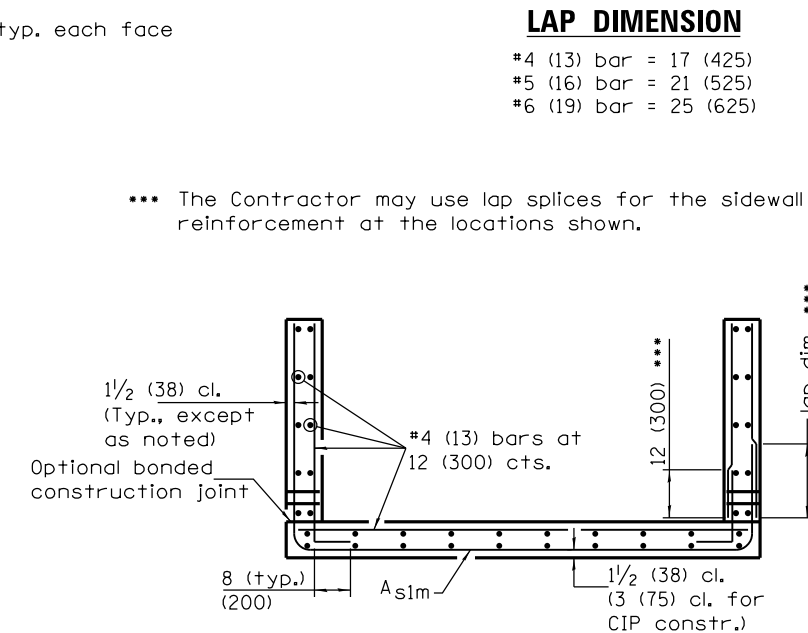


**SECTION C-C**


**LAP DIMENSION**

- #4 (13) bar = 17 (425)
- #5 (16) bar = 21 (525)
- #6 (19) bar = 25 (625)


\*\*\* The Contractor may use lap splices for the sidewall reinforcement at the locations shown.

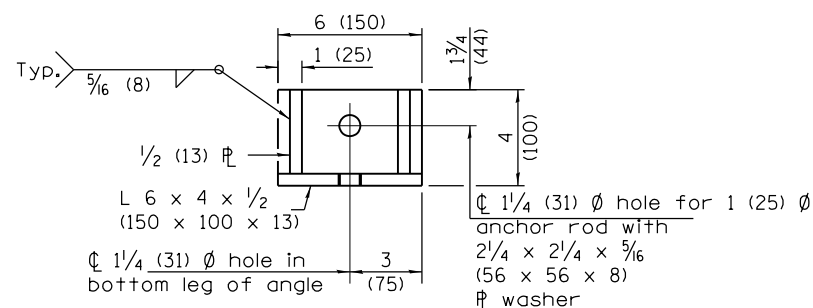


**RESTRAINT ANGLE DETAIL**

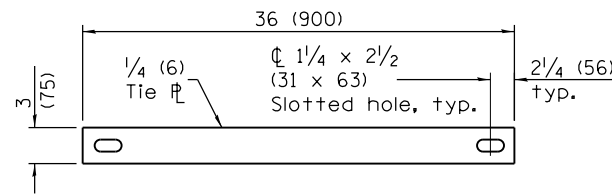

**TIE PLATE DETAIL**

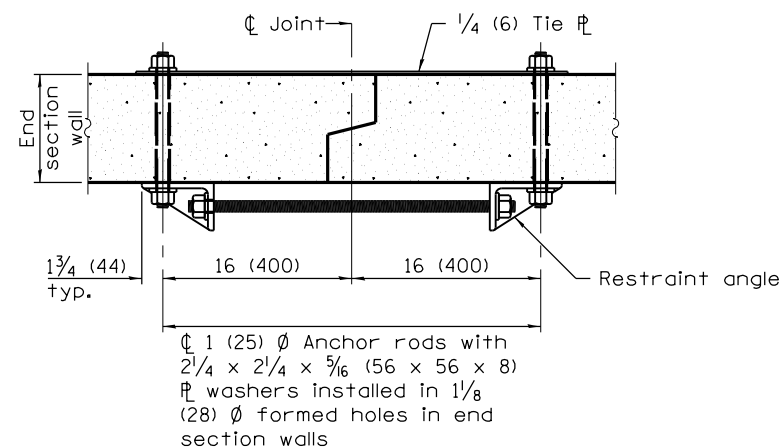

**SECTION A-A**  
(Showing end section tie details.)

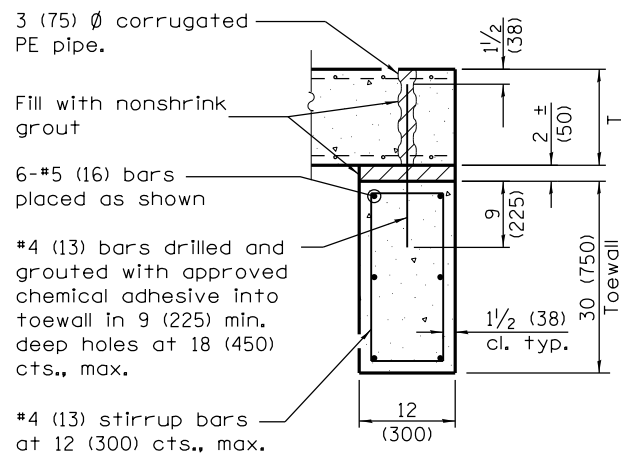

**SECTION D-D**

**REINFORCEMENT SCHEDULE**

Equivalent Round Size Pipe I.D.	A <sub>s1m</sub>	
	Bar Size	Bar Spacing
15 (375)	4 (13)	12 (300)
18 (450)	4 (13)	12 (300)
21 (525)	4 (13)	12 (300)
24 (600)	4 (13)	12 (300)
27 (700)	4 (13)	12 (300)
30 (750)	4 (13)	12 (300)
36 (900)	4 (13)	12 (300)
42 (1050)	4 (13)	12 (300)
48 (1200)	4 (13)	8 (200)
54 (1350)	4 (13)	8 (200)
60 (1500)	4 (13)	8 (200)
66 (1650)	5 (16)	8 (200)
72 (1800)	5 (16)	8 (200)

**CONCRETE END SECTIONS FOR ELLIPTICAL PIPE CULVERTS 15" (375 mm) THRU 72" (1800 mm) EQUIVALENT DIAMETER**

(Sheet 2 of 3)

**STANDARD 542011-02**

Illinois Department of Transportation

APPROVED April 15, 2016  
*[Signature]*  
 ENGINEER OF BRIDGES AND STRUCTURES

APPROVED April 15, 2016  
*[Signature]*  
 ENGINEER OF DESIGN AND ENVIRONMENT

ISSUED 1-1-13

**QUANTITIES**

Equivalent Round Size Pipe I.D.	Concrete yd <sup>3</sup> (m <sup>3</sup> ) ①				Reinforcement Without Lap lbs. (kg)				Reinforcement With Lap lbs (kg)			
	Slope of End Section				Slope of End Section				Slope of End Section			
	1:2	1:3	1:4	1:6	1:2	1:3	1:4	1:6	1:2	1:3	1:4	1:6
15 (375)	1.5 (1.1)	1.9 (1.6)	2.3 (1.8)	3.0 (2.3)	220 (120.8)	270 (148.3)	320 (172.9)	420 (228.5)	240 (132.3)	300 (164.3)	350 (192.8)	470 (257.4)
18 (450)	1.5 (1.3)	1.9 (1.6)	2.3 (1.8)	3.0 (2.3)	220 (120.8)	270 (148.3)	320 (172.9)	420 (228.5)	240 (132.3)	300 (164.3)	350 (192.8)	470 (257.4)
21 (525)	2.2 (1.7)	2.8 (2.1)	3.5 (2.7)	4.8 (3.7)	310 (167.2)	390 (172.9)	470 (211.5)	630 (285.2)	330 (181.8)	420 (189.3)	520 (232.9)	700 (316.3)
24 (600)	2.2 (1.7)	2.8 (2.1)	3.5 (2.7)	4.8 (3.7)	310 (167.2)	390 (172.9)	470 (211.5)	630 (285.2)	330 (181.8)	420 (189.3)	520 (232.9)	700 (316.3)
27 (700)	2.5 (1.9)	3.2 (2.4)	3.9 (3.0)	5.4 (4.1)	330 (181.7)	420 (190.1)	510 (231.4)	690 (310.5)	360 (197.0)	460 (208.0)	560 (254.3)	760 (343.1)
30 (750)	2.7 (2.1)	3.5 (2.7)	4.3 (3.3)	5.9 (4.5)	350 (193.1)	450 (201.9)	540 (244.9)	730 (331.3)	380 (209.5)	490 (220.4)	600 (268.7)	810 (365.3)
36 (900)	3.3 (2.5)	4.4 (3.4)	5.4 (4.1)	7.5 (5.7)	430 (237.6)	560 (252.2)	690 (309.3)	940 (423.4)	470 (255.8)	610 (273.0)	740 (335.9)	1020 (461.8)
42 (1050)	4.0 (3.1)	5.3 (4.1)	6.6 (5.0)	9.2 (7.0)	510 (279.8)	660 (295.6)	820 (369.1)	1120 (508.5)	550 (299.8)	700 (317.9)	880 (398.7)	1220 (551.3)
48 (1200)	4.7 (3.6)	6.2 (4.7)	7.8 (6.0)	10.9 (8.3)	660 (362.5)	870 (391.5)	1070 (485.4)	1490 (672.8)	710 (389.5)	940 (422.8)	1160 (525.7)	1610 (731.4)
54 (1350)	5.3 (4.1)	7.2 (5.5)	9.0 (6.9)	12.6 (9.6)	730 (400.1)	960 (434.4)	1190 (540.2)	1670 (756.6)	780 (428.9)	1030 (467.9)	1290 (583.7)	1810 (820.5)
60 (1500)	6.3 (4.8)	8.5 (6.5)	10.7 (8.2)	15.1 (11.5)	830 (458.1)	1110 (500.0)	1390 (629.0)	1950 (882.2)	890 (488.7)	1180 (535.9)	1490 (676.2)	2100 (951.4)
66 (1650)	7.1 (5.4)	9.6 (7.3)	12.2 (9.3)	17.2 (13.2)	1080 (596.0)	1470 (665.5)	1840 (836.2)	2610 (1185.3)	1180 (650.1)	1610 (729.0)	2030 (918.3)	2880 (1306.3)
72 (1800)	8.2 (6.3)	11.1 (8.5)	14.0 (10.7)	19.8 (14.9)	1190 (653.9)	1620 (734.2)	2050 (931.6)	2930 (1328.9)	1290 (710.7)	1770 (801.7)	2250 (1019.9)	3220 (1460.0)

① For cast-in-place construction, increase concrete volumes by approximately 13%.

**GENERAL NOTES**

This Standard is used with single pipe culverts and multi-pipe culvert installations. For multi-pipe culvert installations, place the end sections side-by-side leaving a 3 (75) space between adjacent end section walls and fill the space(s) with Class SI concrete.

The number of segments shown in elevation is for example only. The length and number of precast sections required to construct the end section shall be determined by the Contractor.

See roadway plans for slope (V:H) and pipe inside diameter.

End section may be installed up to ± 15 degrees skewed with roadway.

2/4 x 2/4 x 5/16 (56 x 56 x 8) plate washers shall be provided under each nut required for the anchor rods. Holes in the walls for the culvert tie assembly may be drilled using core bits in lieu of formed holes.

See Standard 542311 for end sections having traversable pipe grate.




All slope ratios are expressed as units of vertical displacement to units of horizontal displacement (V:H).

All dimensions are in inches (millimeters) unless otherwise shown.

**CONCRETE END SECTIONS FOR ELLIPTICAL  
PIPE CULVERTS 15" (375 mm)  
THRU 72" (1800 mm) EQUIVALENT DIAMETER**

(Sheet 3 of 3)

**STANDARD 542011-02**

 Illinois Department of Transportation	ISSUED 1-1-13
APPROVED <u>April 15, 2016</u>  ENGINEER OF BRIDGES AND STRUCTURES	
APPROVED <u>April 15, 2016</u>  ENGINEER OF DESIGN AND ENVIRONMENT	
Illinois Department of Transportation	